

# GRUPPO DI RIDUZIONE GPL 1° STADIO

Q = 80 kg/h

LPG first stage reduction group

Group de reduction GPL de premiere saut

**COPRIM - ITALY**

RISPONDENTE A NORMATIVA ATEX

In according with Atex Normative

Aux termes de la norme ATEX




Cod. 1.37.09



con elettrovalvola 1/2" EExd  
with 1/2" electrovalve  
avec eletrovanne de 1/2" EExd

Cod. 1.37.10

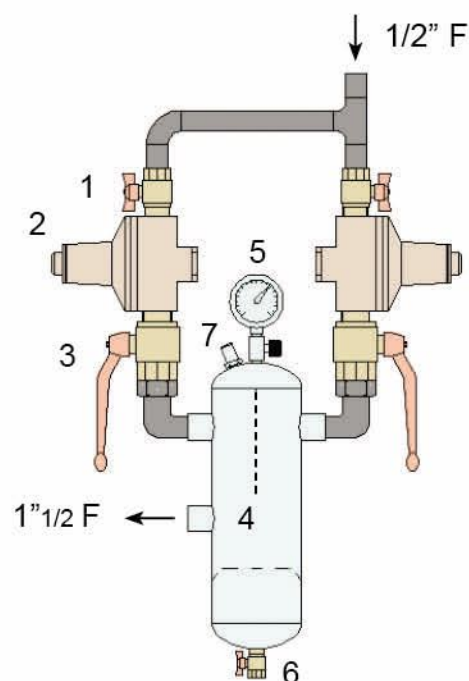

P<sub>1</sub> = 2 ÷ 18 bar

P<sub>2</sub> = 0,5 bar

a richiesta - on request - sur demande  
max 1,5 bar

| Pos. | Descrizione                                | Description         | Description     | DN        | PN |
|------|--------------------------------------------|---------------------|-----------------|-----------|----|
| 1    | Valvola a sfera M/F "Coprìim"              | Vanne sphérique     | Ball valve      | 1/2"      | 40 |
| 2    | Riduttore di pressione "Coprìim RED 80 AP" | Détendeur           | Gas regulator   | 1/2" - 1" | 40 |
| 3    | Valvola a sfera M/F "Coprìim"              | Vanne sphérique     | Ball valve      | 1"        | 40 |
| 4    | Barilotto di condensa                      | Barilet de condense | Condensate tank | 4"        | 16 |
| 5    | Manometro Ø 60                             | Manomètre           | Pressure gauge  | 1/4"      | -  |
| 6    | Valvola a sfera di spurgo                  | Vanne sphérique     | Ball valve      | 1/4"      | 16 |
| 7    | Valvola di sicurezza                       | Soupape de securité | Safety valve    | 1/4"      | -  |